GENERAL NOTES:
1. PUMPER NOZZLE SHALL HAVE 4 1/2-INCH OUTLET WITH NATIONAL STANDARD THREADS.
2. INSTALL A 5-INCH HIGH STRENGTH ALUMINUM ALLOY, TEFLON COATED STORZ ADAPTER WITH RUBBER GASKET AND SET SCREWS TO SECURE IT IN PLACE. THE ADAPTER SHALL BE PROVIDED WITH AN APPROVED ALUMINUM ALLOY PRESSURE CAP ATTACHED TO THE HYDRANT BARREL WITH AN APPROVED CABLE.
3. FIRE HYDRANT SHOULD BE PLACED ADJACENT TO SIDEWALKS OR CURBS UNLESS OTHERWISE DIRECTED BY THE ENGINEER.
4. PAINT SHALL BE PITTSBURGH PAINT SAFETY ORANGE #90313.

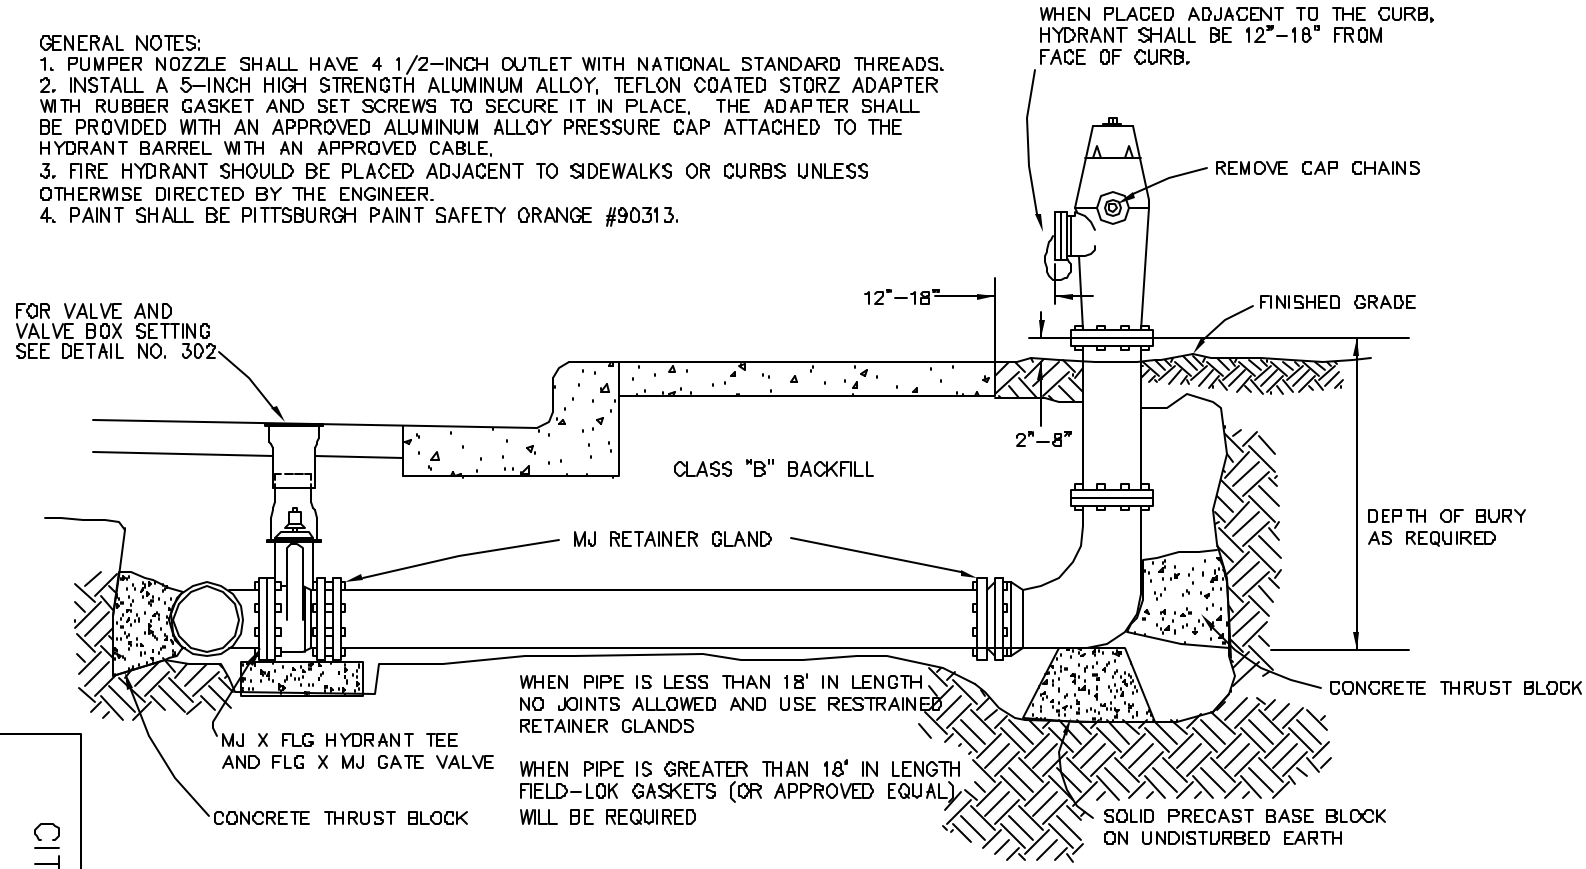

CITY OF CORVALLIS
ENGINEERING DIVISION

FIRE HYDRANT SETTING

DATE: JULY, 2005
SCALE: NONE
STANDARD DETAIL No. 303
APPROVED: